




EXISTING PLAN (lower ground floor)

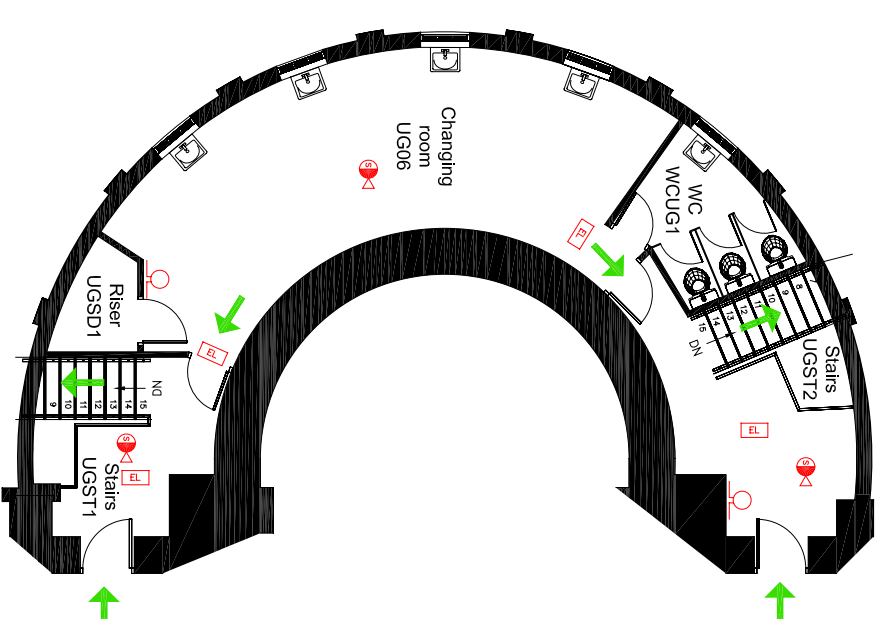

EXISTING PLAN (upper ground floor)

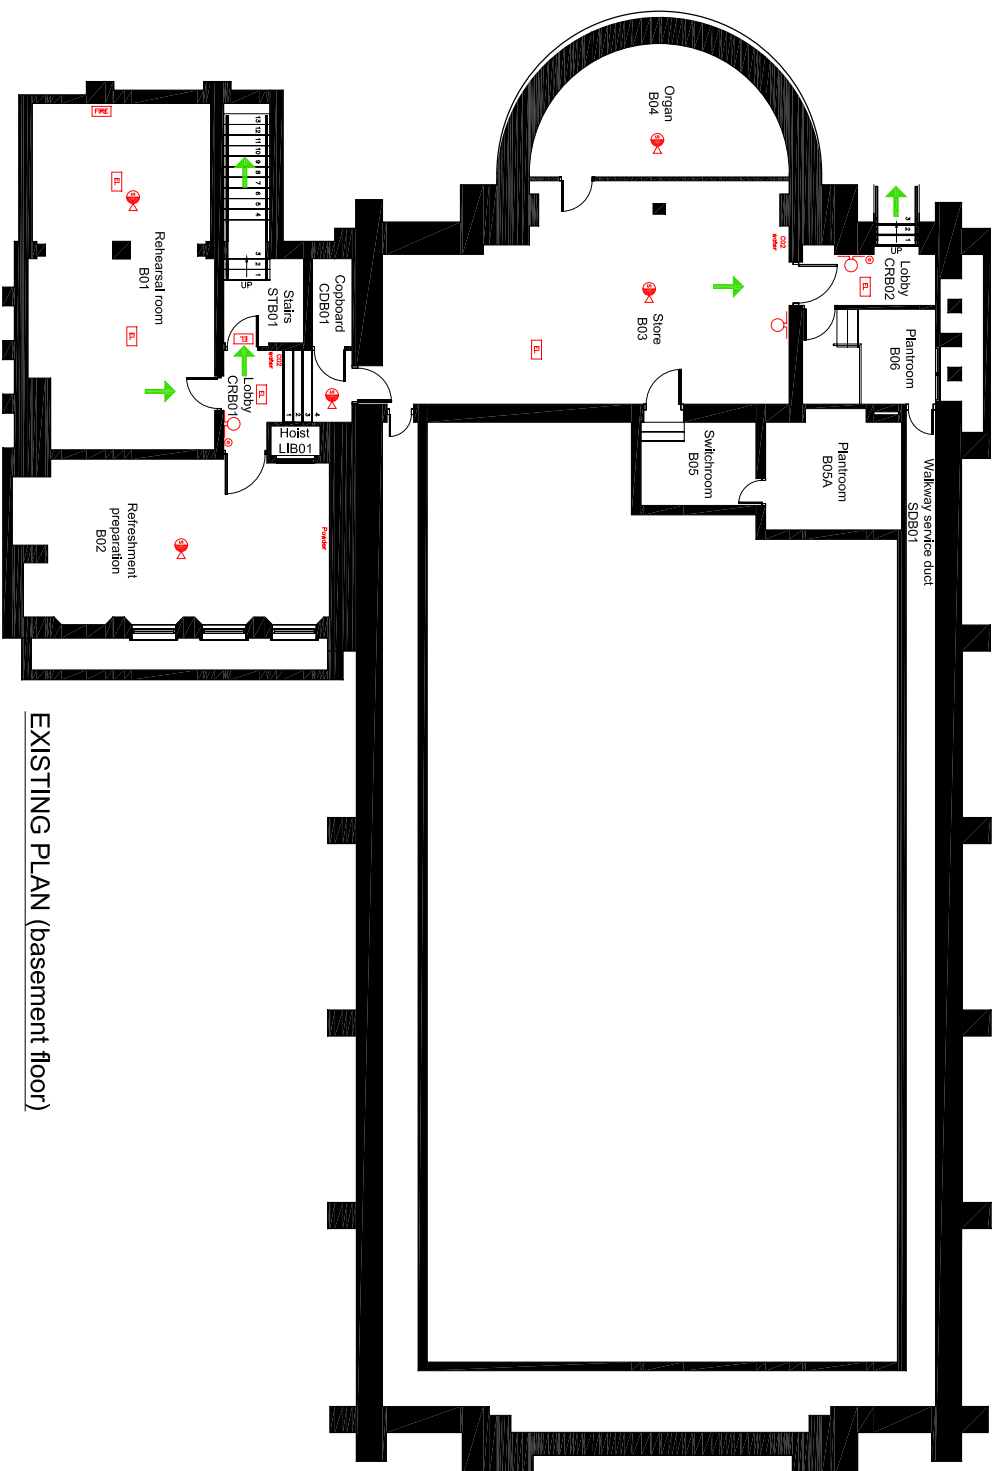

EXISTING PLAN (basement floor)

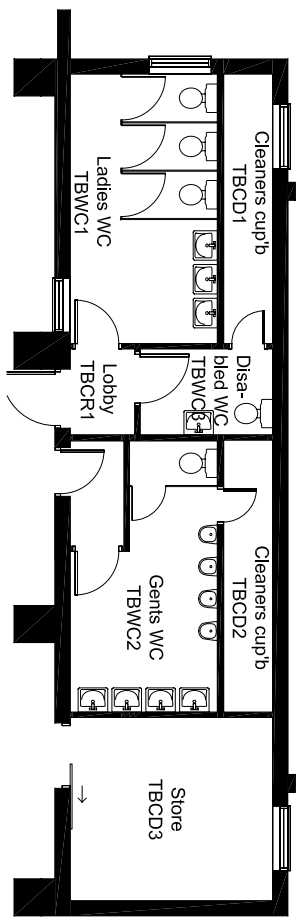

EXISTING PLAN (toilet block floor)

SYMBOL KEY	
	Exit Route
	Final Exit
	Fire Extinguisher
	Fire Alarm Call Point
	Fire Alarm Panel
	Smoke Detector/Sounder
	Sounder
	Emergency Light Fitting

B	29/01/07	Notes added	AH
A	3-1-07	Plan updated	AH
REV	DATE	NOTES	BY

Do not scale from this drawing - all dimensions to be checked on site

Notes:

Ensure the organ fire damper interface is disabled in the event of operation of the fire alarm system.

The University of Reading

FIRE SAFETY PLAN
L045

